

ABSOLUTE, DIFFERENTIAL AND GAUGE PRESSURE TRANSMITTER FOR REMOTE SEAL(S)

DATA SHEET

FKB, FKD, FKM...F

The FCX-AII series absolute, differential and gauge pressure transmitters accurately measures and transmits proportional 4 to 20 mAdc signal.

The transmitters utilize the unique micromachined capacitive silicon sensor with state-of-the-art microprocessor technology to provide exceptional performance and functionality.

FEATURES

1. High accuracy

0.065% accuracy is a standard feature for differential and gauge pressure models and 0.2% accuracy for absolute pressure models.

The microcapacitance silicon sensor assures this feature for all elevated or suppressed calibration ranges without additional adjustment.

2. Minimum inventory and design

Electronics unit, local indicators and electronics housing are interchangeable among all FCX-AII transmitters.

Our differential, gauge and absolute pressure transmitters for remote seal(s) are welded design with reduced volume flange welded on cell's body to guarantee a perfect vacuum tightness and high pressure services.

3. Minimum environmental influence

The "Advanced Floating Cell" design which protects the pressure sensor against changes in temperature, and over-pressure substantially reduces total measurement error in actual field applications.

4. Fuji/HART® bilingual communications protocol

FCX-AII series transmitter offers bilingual communications to speak both Fuji proprietary protocol and HART®. Any HART® compatible devices can communicate with FCX-AII.

5. Application flexibility

Various options that render the FCX-AII suitable for almost any process applications include:

- Full range of hazardous area approvals
- Built-in RFI filter and lightning arrester
- 5-digit LCD meter with engineering unit
- Stainless steel electronics housing
- Wide selection of materials
- High temperature, high vacuum seals

6. Programmable output Linearization Function

Output signal can be freely programmable. Up to 14 compensated points at approximation.

7. Burnout current flexibility (Under Scale: 3.2 to 4.0 mA, Over Scale: 20.0 to 22.5 mA)

Burnout signal level is adjustable using Model FXW or Hand Held Communicator (HHC) to comply with NAMUR NE43.

8. Dry calibration without reference pressure

Thanks to the best combination of unique construction of mechanical parts (Sensor unit) and high performance electronics circuit (Electronics unit), reliability of dry calibration without reference pressure is at equal level as wet calibration.



SPECIFICATIONS

Functional specifications

Type:

- FKD : differential pressure transmitter with remote seal(s)
- FKB : gauge pressure transmitter with remote seal
- FKM : absolute pressure transmitter with remote seal

Service :

Liquid, gas, or vapour

Span, range, and overrange limit :

Span limits			Range limits
Model	Minimum	Maximum	
	FKD		
	(mbar)	(mbar)	(mbar)
F□D□□3	3.2	320	± 320
F□D□□5	13	1300	± 1300
F□D□□6	50	5000	± 5000
F□D□□8	300	30000	± 30000
F□D□□9*	2000	200000	±200000
	FKB		
	(bar)	(bar)	(bar)
F□B□□1	0,013	1,3	-1 to + 1,3
F□B□□2	0,05	5	-1 to + 5
F□B□□3	0,3	30	-1 to + 30
F□B□□4	1	100	-1 to + 100
F□B□□5	5	500	-1 to + 500
	FKM		
	(bar abs)	(bar abs)	(bar abs)
F□M□□1	0,016	0,16	0 to +0,16
F□M□□2	0,013	1,3	0 to +1,3
F□M□□3	0,05	5	0 to +5
F□M□□4	0,3	30	0 to +30
F□M□□5	1	100	0 to +100

Remark: To minimize environmental influence, span should be greater than 1/40 of the max. span in most applications.

*Important : For FKD#49, max possible overload pressure on LP side must be ≤ 100 bar. The accuracy is not guaranteed when used at negative DP.


Output signal :

4 to 20 mA DC (linear or square root) with digital signal superimposed on the analogic signal

Power supply :

Transmitter operates on 10.5 to 45 V DC at transmitter terminals.

10.5 to 32 V DC for the units with optional arrester.

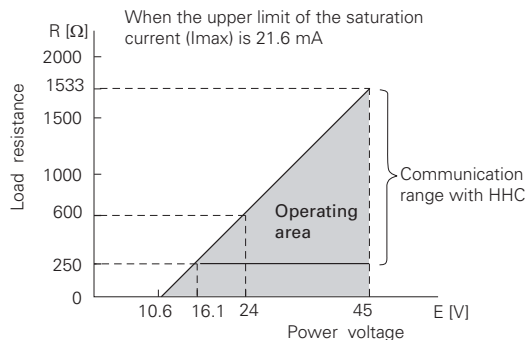Load limitations : see figure below


Note) The load resistance varies with the upper limit of the saturation current (I_{max})

$$R [\Omega] = \frac{E [V] - 10.5}{(I_{max} [mA] + 0.9) \times 10^{-3}}$$

Note: For communication with HHC⁽¹⁾ min. of 250 Ω is required.

Hazardous locations :

Authority (Digit 10 =)	Intrinsic safety																						
ATEX (K)	Ex II 1 G Ex ia IIC T5 (-40°C ≤ Ta ≤ +50 °C) Ex ia IIC T4 (-40°C ≤ Ta ≤ +70 °C) IP66/67 Entity Parameters: Ui ≤ 28 Vdc, Ii ≤ 94.3 mA, Pi ≤ 0.66 W Ci = 36 nF/26 nF for models with/without Arrester Li = 0.7 mH/0.6 mH for models with/without Analog Indicator																						
Factory Mutual (H)	Class I II III Div.1 Groups A, B, C, D, E, F, G T4 Entity Type 4X <table><tr><th colspan="2">Model code</th><th rowspan="2">Tamb</th></tr><tr><th>9th digit</th><th>13th digit</th></tr><tr><td>A,B,C,D,J</td><td>Y,G,N</td><td>-40°C to +85°C</td></tr><tr><td>L,P,M,1,2,3</td><td>Y,G,N</td><td>-20°C to +80°C</td></tr><tr><td>Q,S,N,4,5,6</td><td>Y,G,N</td><td>-20°C to +60°C</td></tr><tr><td>E,F,G,H,K</td><td>Y,G,N</td><td>-40°C to +60°C</td></tr><tr><td>-</td><td>W,A,D</td><td>-10°C to +60°C</td></tr></table> Entity Parameters: Vmax=42.4V, Imax=113mA, Pi=1W, Ci=35.98nF, Li=0.694mH			Model code		Tamb	9th digit	13th digit	A,B,C,D,J	Y,G,N	-40°C to +85°C	L,P,M,1,2,3	Y,G,N	-20°C to +80°C	Q,S,N,4,5,6	Y,G,N	-20°C to +60°C	E,F,G,H,K	Y,G,N	-40°C to +60°C	-	W,A,D	-10°C to +60°C
Model code		Tamb																					
9th digit	13th digit																						
A,B,C,D,J	Y,G,N	-40°C to +85°C																					
L,P,M,1,2,3	Y,G,N	-20°C to +80°C																					
Q,S,N,4,5,6	Y,G,N	-20°C to +60°C																					
E,F,G,H,K	Y,G,N	-40°C to +60°C																					
-	W,A,D	-10°C to +60°C																					
CSA (J)	Ex ia Class I, Groups A, B, C and D; Class II, Groups E, F and G; Class III Per drawing TC 522873 Temp. code T5 for Tamb max = +50°C Temp. code T4 for Tamb max = +70°C Entity Parameters: Vmax = 28 Vdc, Imax = 94.3 mA, Pmax = 0.66 W Ci = 36 nF/25 nF for models with/without Arrester Li = 0.7 mH/0.6 mH for models with/without Analog Indicator																						
IECEX (T)	Ex ia IIC T5 (-40°C ≤ Ta ≤+50 °C) Ex ia IIC T4 (-40°C ≤ Ta ≤+70 °C) IP66/67 Entity Parameters: Ui ≤ 28 Vdc, Ii ≤ 94.3 mA, Pi ≤ 0.66 W Ci = 36 nF/26 nF for models with/without Arrester Li = 0.7 mH/0.6 mH for models with/without Analog Indicator																						

Authority	Flameproof
ATEX (X)	Ex II 2 GD Ex d IIC T6 (-40°C ≤ Ta ≤ +65 °C) Ex d IIC T5 (-40°C ≤ Ta ≤ +85 °C) Ex tD A21 IP66/67 T 85°C Ex tD A21 IP66/67 T 100°C Electrical ratings Model Without arrester: Ui ≤ 45 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W Model With arrester: Ui ≤ 32 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W
Factory Mutual (D)	Class I Div.1 Groups B, C, D T6 Type 4X Class II III Div.1 Groups E, F, G T6 Type 4X Tamb max = +60°C
CSA (E)	Class I, Groups C and D; Class II, Groups E, F and G; Class III Maximum ambient temperature 85°C Maximum working pressure 50 Mpa Electrical ratings Model Without arrester: Ui ≤ 45 Vdc, 4-20 mA Model With arrester: Ui ≤ 32 Vdc, 4-20 mA Note: "Seal not required"
IECEX (R)	Ex d IIC T6 (-40°C ≤ Ta ≤ +65 °C) Ex d IIC T5 (-40°C ≤ Ta ≤ +85 °C) DIP A21 IP66/67 T 85°C DIP A21 IP66/67 T 100°C Electrical ratings Model Without arrester: Ui ≤ 45 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W Model With arrester: Ui ≤ 32 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W

Authority (Digit 10 =)	Type n Nonincendive																							
ATEX (P)	Ex II 3 G Ex nA II T5 (-40°C ≤ Ta ≤+70 °C) IP66/67 Electrical ratings Model Without arrester: Ui ≤ 45 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W Model With arrester: Ui ≤ 32 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W Optional Analog indicator is not available for type "n"																							
Factory Mutual (H)	Class I II III Div.2 Groups A, B, C, D, F, G T4 Entity Type 4X <table><tr><th colspan="2">Model code</th><th>Tamb</th></tr><tr><th>9th digit</th><th>13th digit</th><td></td></tr><tr><td>A,B,C,D,J</td><td>Y,G,N</td><td>-40°C to +85°C</td></tr><tr><td>L,P,M,1,2,3</td><td>Y,G,N</td><td>-20°C to +80°C</td></tr><tr><td>Q,S,N,4,5,6</td><td>Y,G,N</td><td>-20°C to +60°C</td></tr><tr><td>E,F,G,H,K</td><td>Y,G,N</td><td>-40°C to +60°C</td></tr><tr><td>-</td><td>W,A,D</td><td>-10°C to +60°C</td></tr></table>			Model code		Tamb	9th digit	13th digit		A,B,C,D,J	Y,G,N	-40°C to +85°C	L,P,M,1,2,3	Y,G,N	-20°C to +80°C	Q,S,N,4,5,6	Y,G,N	-20°C to +60°C	E,F,G,H,K	Y,G,N	-40°C to +60°C	-	W,A,D	-10°C to +60°C
Model code		Tamb																						
9th digit	13th digit																							
A,B,C,D,J	Y,G,N	-40°C to +85°C																						
L,P,M,1,2,3	Y,G,N	-20°C to +80°C																						
Q,S,N,4,5,6	Y,G,N	-20°C to +60°C																						
E,F,G,H,K	Y,G,N	-40°C to +60°C																						
-	W,A,D	-10°C to +60°C																						
CSA (J)	Class I Div.2 Groups A, B, C, D Class II Div.2 Groups E, F, G Class III Div.2 Temp Code T5 Tamb max = +50°C Temp Code T4 Tamb max = +70°C Entity Parameters: Vmax = 28 Vdc, Imax = 94.3 mA, Pmax = 0.66 W Ci = 36 nF/25 nF for models with/without Arrester Li = 0.7 mH/0.6 mH for models with/without Analog Indicator																							
IECEX (Q)	Ex nA II T5 (-40°C ≤ Ta ≤+70 °C) IP66/67 Electrical ratings Model Without arrester: Ui ≤ 45 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W Model With arrester: Ui ≤ 32 Vdc, 4-20 mA loop powered, Pi ≤ 1.0125 W Optional Analog indicator is not available for type "n"																							

Zero/span adjustment :

Zero and span are adjustable from the HHC⁽¹⁾. Zero and span are also adjustable externally from the adjustment screw.

Damping :

Adjustable from HHC or local adjustment unit with LCD display.

The time constant is adjustable between 0,06 to 32 sec

Zero elevation/suppression :

Zero can be elevated or suppressed within the specified range limit of each sensor model between -100% to +100% of URL for FKD.

FKB : -1 bar to 100% of URL.

Normal/reverse action :

Selectable from HHC⁽¹⁾.

Indication :

Analog indicator or 5-digit LCD meter, as specified.

A plug-in analog indicator can be mounted on the electronics unit or the terminal block.

Burnout direction : Selectable from HHC⁽¹⁾

If self-diagnostic detect transmitter failure, the analog signal will be driven to either "Output Hold", "Output Overscale" or "Output Underscale" modes.

"Output Hold":


Output signal is hold as the value just before failure happens.

"Output Overscale":

Adjustable within the range 20.0 mA to 22.5 mA from HHC⁽¹⁾

"Output Underscale":

Adjustable within the range 3.2 mA to 4.0 mA from HHC⁽¹⁾

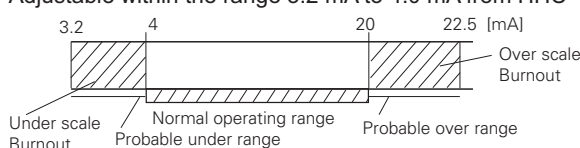

Output Limits conforming the NAMUR NE43 by order.

Loop-check output :

Transmitter can be configured to provide constant signal 3.2 mA through 22.5 mA by HHC⁽¹⁾.

Temperature limit :

Ambient: -40 to +85°C

-20 to +80°C (for LCD indicator)

-40 to +60°C (for arrester option)

-20 to +60°C (for fluorinated oil fill transmitter)

For explosionproof units (flameproof or intrinsic safety), ambient temperature must be within the limits specified by each standard.

Process: Check in the seal - datasheet with the specific temperature conditions.

Storage: -40 to +90°C

Humidity limit :

0 to 100% RH (Relative Humidity)

Communication :

With HHC⁽¹⁾ (model FXW, consult DS No.EDS8-47), following items can be remotely displayed or configured.

Note: HHC's version must be higher than 7.0 (or FXW□□□□1-□4), for FCX-ALL for supporting these items: "Saturate current", "Write protect".

Items	Fuji Protocol with FXW		Hart® Protocol		By local configurator (with 3 push button), (LCD indicator)	
	Display	Set	Display	Set	Display	Set
Tag No.	✓	✓	✓	✓	✓	✓
Model No.	✓	✓	✓	✓	✓	✓
Serial No. & Software Version	✓	—	✓	—	✓	—
Engineering unit	✓	✓	✓	✓	✓	✓
Range limit	✓	—	✓	—	✓	—
Measuring range	✓	✓	✓	✓	✓	✓

Damping	✓	✓	✓	✓	✓	✓
Output mode	Linear	✓	✓	✓	✓	✓
	Square root	✓	✓	✓	✓	✓
Burnout direction	✓	✓	✓	✓	✓	✓
Calibration	✓	✓	✓	✓	✓	✓
Output adjust	—	✓	—	✓	—	✓
Data	✓	—	✓	—	✓	—
Self diagnoses	✓	—	✓	—	✓	—
Printer (In case of FXW with printer option)	✓	—	—	—	—	—
External switch lock	✓	✓	✓	✓	✓	✓
Transmitter display	✓	✓	✓	✓	✓	✓
Linearize*	✓	✓	—	—	—	—
Rerange	✓	✓	✓	✓	✓	✓
Saturate current	✓	✓	✓	✓	✓	✓
Write protect	✓	✓	✓	✓	✓	✓
History						
– Calibration history	✓	✓	✓	✓	✓	✓
– Ambient temperature history	✓	—	✓	—	✓	—

(Note) (1) HHC: Hand Held Communicator

***Local configurator with LCD display (option) :**

Local configurator with 3 push button and LCD display can support all items (Fuji Protocol list) except "Linearize" function.

Programmable output linearization function :

Output signal can be characterized with "14 points linear approximation function" from HHC⁽¹⁾.

Performance specifications

Reference conditions, silicone oil fill, SS 316L isolating diaphragms, 4 to 20 mA analog output.

Accuracy rating :

(including linearity, hysteresis, and repeatability)

For span greater than 1/10 of URL :

± 0,065% of calibrated span (FKB & FKD)

± 0,1% of calibrated span for FKB□□5VF

± 0,2% of calibrated span for FKM

For span smaller than 1/10 of URL :

± (0,015 + 0,05 x 0,1 x URL/span) % of span (FKB & FKD)

± (0,1 + 0,1 x 0,1 x URL/span) % of span (FKM)

Stability :

± 0.2% of upper range limit (URL) for 10 years.

Linearity :

0,05% of calibrated span (FKB & FKD)

0,1% of calibrated span (FKM)

Temperature effect :

Effect per 28°C change between -40°C and +85°C

Model FKM :

Zero shift :

±(0,125 + 0,1 x URL/span) % of URL

Total effect :

±(0,15 + 0,1 x URL/span) % of URL

Model FKB & FKD :

Zero shift :

±(0,075 + 0,0125% URL/span) % of URL

Total effect :

±(0,095 + 0,0125% URL/span) % of URL

Static pressure effect (FKD) :

Zero shift : ± 0,035% of URL for 100 bar

Overrange effect (FKB & FKM) :

Zero shift : 0,2% of URL, for any overrange pressures (limited to the max. overrange pressure)

Overrange effect (FKD) :

Zero shift : $\pm 0,15\%$ of URL / 160 bar limit

Supply voltage effect :

Less than 0.005% of calibrated span per 1V

RFI effect :

< 0,2% of URL for the frequencies of 20 to 1000 MHz and field strength of 10 V/m when electronic housing covers are on (Classification : 2-abc : 0,2% of span according SAMA PMC 33.1)

Update rate : 60 msec

Response time : (at 63,3% of output signal without damping)

Time constant : 300 msec (FKD span code "3")

Time constant : 200 msec (other spans and FKB, FKM)

Dead time : 300 msec

Response time = time constant + dead time

Mounting position effect :

Zero shift : < 12 mm CE for 10° incline in any position. This shift can be corrected with the zero adjustment.

This effect is doubled for fluorinated oil filling.

No influence on span adjustment.

Vibration effect :

< $\pm 0,25\%$ of span for spans greater than 1/10 of URL.

Frequency 10 to 150 Hz, acceleration 39,2 m/sec².

These informations are available only for capillary mounting.

Material fatigue :

Please consult Fuji Electric

Dielectric strength:

500 V AC, 50/60 Hz 1 min., between circuit and earth.

Insulation resistance :

More than 100 M Ω / 500 V DC.

Internal resistance for external field indicator :

12 Ω maxi (connected to test terminal CK+ and CK-)

Pressure equipment directive (PED) 97/23/EC

FKD: According to Article 3.3

FKB: Digit 6 code 1, 2, 3, 4 according to Article 3.3

Digit 6 code 5 : Category III module B

FKM: According to Article 3.3

Physical specifications

Electrical connections :

1/2"-14 NPT, Pg 13,5 or M20 x 1,5

Process-wetted parts material :

Diaphragm : SS 316L, Hastelloy-C, Monel, Tantalum, Titanium or Zirconium

Flange face : SS 316L, Hastelloy-C, Monel, Tantalum, Titanium or Zirconium

Extension : SS 316L, Hastelloy-C

(Refer to "Code symbols")

Non-wetted parts material :

Electronics housing :

Low copper die-cast aluminum alloy finished with polyester coating (standard), or SS 316 as specified.

Bolts and nuts :

Standard : Cr-Mo alloy

Option : SS 316 (L) for pressure $\leq$ 100 bar or SS 660 for pressure > 100 bar

Fill fluid :

Standard : Silicone oil

Option : fluorinated oil

Mounting bracket :

SS 304L or SS 316L

Environmental protection :

IEC IP66/IP67 and NEMA4X

Mounting bracket:

Without : direct mounting

With (option) : On 50 mm (2") pipe or direct wall mounting

Mass {weight} :

Refer to outline dimensions page 12 to 17.

Diaphragm seal(s) :

A comprehensive selection of seals can be chosen in accordance with the specific seal (see datasheet).

Optional features

Indicator :

A plug-in analog indicator (2.5% accuracy) can be housed in the electronics compartment or in the terminal box of the housing.

An optional 5 digit LCD meter with engineering unit is also available.

Local configurator with LCD display :

An optional 5 digits LCD meter with 3 push buttons can support items as using communication with FXW.

Arrester :

A built-in arrester protects the electronics from lightning surges.

Lightning surge immunity: 4 kV (1.2 $\times$ 50 μ s)

NACE specification:

Metallic materials for all pressure boundary parts comply with NACE MR 0175/ISO 15156.

SS 660 bolts and nuts comply with NACE MR 0175/ISO 15156.

Optional tag plate :

An extra stainless steel tag for customer tag data is wired to the transmitter.

Vacuum service : See Fig.1

Special silicone oil and filling procedure are applied.

[Torr]

FKB & FKD type only

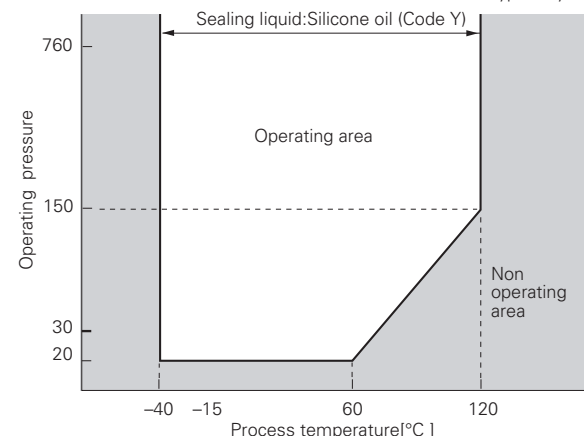


Fig. 1 Relation between process temperature and operating pressure

ACCESSORIES

Hand-held communicator :

(Model FXW, refer to Data Sheet No. EDS8-47)

CODE SYMBOLS - FKB

1	2	3	4	5	6	7	8	9	10	11	12	13	DESCRIPTION																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											
F	K	B			V	F	-					Y																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																												

Notes* :

- Turn down of 100:1 is possible, but should be used at the span greater than 1/10 of the maximum span for better performance.
- Consult FUJI for your application with the specific operating conditions
- For DN < 50 consult FUJI for your application with the specific operating conditions
- Flange rating according max. operating pressure - for DN < 50 flange size and / or PN > 150, consult FUJI
- Transmitter with capillary design has a standard mounting bracket - Rigid monting design are always without monting bracket
- Codify bolts and nuts for all mounting even if p < 50 bar
- Standard fill fluid of measuring cells : silicone oil - Other fill fluids : upon request
- Code "D & V" FM approval only possible with electrical connection 1/2"-14 NPT
- Our bolts/nuts in SS 660 are in conformity with the NACE MR 0175/ISO 15156 requirements and must be used for NACE MR 0175/ISO 15156 service.

CODE SYMBOLS - FKD

1	2	3	4	5	6	7	8	9	10	11	12	13	DESCRIPTION																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																						
F	K	D				V	F	-																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																																											

Notes* :

- Turn down of 100:1 is possible, but should be used at the span greater than 1/10 of the maximum span for better performance
- For DN = 50 consult FUJI for your application with the specific operating conditions
- Transmitter with capillary design has a standard mounting bracket
- If direct mounted seal design is required, bolts are necessary even when p < 50bar
- Standard fill fluid of measuring cells : silicone oil - Others fill fluids : upon request
- Transmitter with different diaphragm seals or capillary lengthes on HP and LP side must be temperature corrected.
- Code "D & V" FM approval only possible with electrical connection 1/2"-14 NPT.
- Our bolts/nuts in SS 660 are in conformity with the NACE MR 0175/ISO 15156 requirements and must be used for NACE MR 0175/ISO 15156 service.
- High static pressure DP measuring cell and M12 bolting required (upon request).

CODE SYMBOLS - FKM

1	2	3	4	5	6	7	8	9	10	11	12	13	DESCRIPTION					
F	K	M			V	F	-				Y							
T V W													Type					
													Smart, 4-20 mAdc + Fuji/Hart® digital signal					
													Conduit connection					
													1/2"-14NPT Pg 13.5 M20 x 1.5					
2 4 6 8 9													Diaphragm seal rating					
													PN 25					
													PN 20 - 150 Lbs					
													PN 50 - 300 Lbs					
													PN 40					
1 2 3 4 5													Spans					
													(*1) 0 to 0.016/0.16 bar abs					
													(*2) 0 to 0.013/1.3 bar abs					
													(*3) 0 to 0.05/5 bar abs					
													0 to 0.3/30 bar abs 0 to 1/100 bar abs					
V F - A V F - B V F - D V F - J V F - E V F - F V F - H V F - K V F - L V F - P V F - Q V F - S V F - 1 V F - 2 V F - 4 V F - 5													Indicator, arrester and initial setting					
														Indicator	Arrester	Initial setting		
														None	None	4-20mA DC + Hart®/Fuji digital signal 'SMART'		
														Analog, 0-100% linear scale	None			
														Analog, Custom scale	None			
														Analog, double scale	None			
														None	Yes			
														Analog, 0-100% linear scale	Yes			
														Analog, Custom scale	Yes			
														Analog, double scale	Yes			
														Digital, 0-100%	None			
														Digital, Custom scale	None			
														Digital, 0-100%	Yes			
														Digital, Custom scale	Yes			
														Digital, 0-100% with push button	None			
														Digital, Custom scale with push button	None			
														Digital, 0-100% with push button	Yes			
														Digital, Custom scale with push button	Yes			
A X K D E H J P Q R T L M N V													Approvals for hazardous locations (consult FUJI for availability)					
														None (Standard)				
														ATEX - Flameproof enclosures (digit 4 = "T" & "W" only)				
														ATEX - Intrinsic Safety				
														(*7) FM - Explosion-Proof (digit 4 = "T" only)				
														CSA - Explosion-Proof (digit 4 = "T" only)				
														FM - Intrinsic Safety and Non Incendive				
														CSA - Intrinsic Safety				
														ATEX - Type "n" (digit 9 = A, E, 1, 2, 3, 4 & 5 only)				
														IECEX - Type "n" (digit 9 = A, E, 1, 2, 3, 4 & 5 only)				
														IECEX - Flameproof enclosures (digit 4 = "T" & "W" only)				
														IECEX - Intrinsic Safety				
														CSA - Explosion-Proof & Intrinsic Safety combined approval (digit 4 = "T" only)				
														ATEX - Flameproof enclosures & Intrinsic Safety combined approval (digit 4 = "T" & "W" only)				
														IECEX - Flameproof enclosures & Intrinsic Safety combined approval (digit 4 = "T" & "W" only)				
														FM - Explosion-Proof & Intrinsic Safety combined approval (digit 4 = "T" only)				
B L M G S T													Mounting design (*4)		Ambiant temperature correction			
													Capillary		Transmitter and diaphragm seal assembly			
													Rigid - long design		Transmitter and diaphragm seal assembly			
													Rigid - short design		Transmitter and diaphragm seal assembly			
													Capillary		Transmitter			
													Rigid - long design		Transmitter			
1 2 3 4 Y B C E A D F G H J K L													Stainless steel parts					
														Operat. pressure (bar)	Bolts/nuts	Tag plate	Housing & mounting bracket	
														1 Y (*6) (*5) p ≤ 50 bar	None (capillary mounting)	None	None	
														2 Y (*6) (*5) p ≤ 50 bar	None (capillary mounting)	Yes	None	
														3 Y (*6) (*5) p ≤ 50 bar	None (capillary mounting)	None	Yes	
														4 Y (*6) (*5) p ≤ 50 bar	None (capillary mounting)	Yes	Yes	
														Y Y (*6) 50 < p ≤ 100	Carbon steel	None	None	
														B Y (*6) 50 < p ≤ 100	Carbon steel	Yes	None	
														C Y (*6) 50 < p ≤ 100	Carbon steel	None	Yes	
														E Y (*6) 50 < p ≤ 100	Carbon steel	Yes	Yes	
														A Y (*6) p ≤ 100 bar	SS 316(L)/SS 316(L)	None	None	
														D Y (*6) p ≤ 100 bar	SS 316(L)/SS 316(L)	Yes	None	
														F Y (*6) p ≤ 100 bar	SS 316(L)/SS 316(L)	None	Yes	
														G Y (*6) p ≤ 100 bar	SS 316(L)/SS 316(L)	Yes	Yes	
														H Y (*6) (*8) p ≤ 100 bar	SS 660/SS 660	None	None	
														J Y (*6) (*8) p ≤ 100 bar	SS 660/SS 660	Yes	None	
														K Y (*6) (*8) p ≤ 100 bar	SS 660/SS 660	None	Yes	
														L Y (*6) (*8) p ≤ 100 bar	SS 660/SS 660	Yes	Yes	

Notes* :

- 1- Turn down of 100:1 is possible, but should be used at the span greater than 1/10 of the maximum span for better performance.
- 2- Consult FUJI for your application with the specific operating conditions
- 3- For DN = 50 consult FUJI for your application with the specific operating conditions
- 4- Transmitter with capillary design has a standard mounting bracket - rigid monting design are always without mounting bracket
- 5- Flange rating according max. operating pressure - for DN < 50 flange size and / or PN > 150 - consult FUJI
- 6- Standard fill fluid of measuring cells : silicone oil - other fill fluids : upon request
- 7- Code "D & V" FM approval only possible with electrical connection 1/2"-14 NPT
- 8- Our bolts/nuts in SS 660 are in conformity with the NACE MR 0175/ISO 15156 requirements and must be used for NACE MR 0175/ISO 15156 service.

DIAPHRAGM SEAL(S)

S

Diaphragm seals designed by Fuji Electric are used to measure accurately liquid level, density on open and closed tanks, or flow measurement in pipes. The use of the diaphragm seal(s) avoid(s) that the measuring cell is directly in contact with the process. The welded seal construction assures excellent reliability in high temperature and high corrosive, viscous, sticking, crystallizable and abrasive process conditions.

FEATURES

1- Construction

The diaphragm seals are mounted on differential, gauge and absolute pressure transmitters of FCX-All series.

The seal can be rigid, (direct) mounted on the transmitter or with capillaries between the seal and the transmitter.

The construction is an all welded design without any gasket between the seal and the transmitter diaphragm and is filled with the suitable oil for your application.

2- Operating principle

The measuring pressure is applied on the diaphragm seal and transferred by the filling fluid through the capillary tube to the measuring cell of the pressure transmitter.

3- Parts materials

Wetted parts materials (diaphragm and gasket face) are in stainless steel, Tantalum, Hastelloy, Monel, Titanium, Zirconium, Nickel, depending on the application requirements.

Other parts are in stainless steel : capillary tube, reduced volume flange, diaphragm seal body, direct mounting connection parts. Standard filling fluid is silicone oil.

Fluorinated oil, sanitary oil, high temperature oil and vacuum service filling are available through model selection.

4- Diaphragm seal types

According to the mounting and operating conditions different seal types can be useful :

Flush mounting design from DN40 to DN100.

Seals with extensions (50 to 200 mm).

Flanged, screwed or weld neck adaptors

Seals for sanitary applications according DIN, SMS or Tri-Clamp standards.

For specifics seals, please consult Fuji Electric.



SPECIFICATIONS

Functional specifications

Diaphragm seal application :

The seal(s) can be mounted direct or rigid on the transmitter (for example for liquid level measurement at the bottom of the tank) or capillary mounted to distance the measuring point away from the transmitter (for example in case of high process temperature). The rigid mounted seal can be assembled in a long design or in a short (compact) design according to the physical dimension requests of the customer (see outline dimensions drawings).

	Rigid mounting	Capillary mounting
FKB	short or long design	HP side
FKM	short or long design	HP side
FKD	see datasheet of level transmitter (FKE)	HP and LP side HP side LP side

Capillary tube specifications :

Standard capillary lengths :

1,5 / 3 / 6 m (other upon request)

Inside diameter :

1 mm standard

2 mm for vacuum service, high process temperature applications, short response time requirements

Smallest bending radius of the capillary : 100 mm

Capillary tube sheald possibilities :

Temperature limit :

PVC sheald : -10 à 80°C

Stainless steel sheald : -40 à 350°C

Process connection possibilities :

The diaphragme seals can be:

- Flush mounting design

- Extension mounting

- Adaptors mounting (flanged, screwed or welded neck).

The adaptors mounting can adapte the remote seals to special connection and to increase the sensibility of the transmitter during special process conditions.

Temperature limits :

Ambiant temperature :

-40 to 85°C for transmitter

Process temperature :

-40 to 150°C for rigid mounting,

0 to 350°C for capillary design, and according to the filling fluid limitations.

Pressure limits :

Working pressure :

Limited by the static pressure or the working pressure of the transmitter or by the nominal flange rating of the diaphragm seal (PN). (Please take the smallest of both)

Vacuum limit :

Depending on the limit of the transmitter and the filling fluid of the seal.

For a differential or gauge pressure transmitter the lowest vacuum is 20 Torr or 27 mbar abs.

Only the absolute pressure transmitter can be used till absolute zero (FKM).

For the utilization of vacuum service < 20 Torr, please consult Fuji Electric.

The absolute pressure transmitter has to be used.

Performance specifications

To calculate the total performance, both the transmitter and the diaphragm seals performances have to be added.

(Under reference conditions, Silicone oil fill, isolated seals SS 316L, analogic output 4/20 mA at linear mode)

Accuracy :

The assembling of 1 or 2 diaphragm seals on a transmitter increases the accuracy error at reference conditions of 0,1% of the span.

Ambiant temperature effect :

Effect when transmitter alone is corrected.

(See digit 11 code G, S, T of the code symbols FKB and FKM and code G, H of the code symbols FKD).

Seals	DN 50 / 2" SS diaphr.	DN 80 / 3" SS diaphr.	DN 80 / 3" other diaph. materials	DN 100 / 4" SS diaphr.	Adaptor SS diaphr.
Transmitters					
FKB/FKM - gauge / abs pressure	2.03	0.11	0.22	0.04	0.11
capillary(m)	1.5	0.08	0.2	0.03	0.08
FKD - differential pressure	0.48	0.04	0.05	0.02	0.04
capillary (m)	0.32	0.03	0.07	0.01	0.03

Note : the indicated values are in mbar/10°C for capillary length of 1m and internal capillary tube $\varnothing$ of 1 mm

Effect when transmitter and the seal assembly is corrected.
(See codes B,C,L,M digit 11 of the codification FKB, FKD and FKM).

According to the complete transmitter design (transmitter and seals), a strong correction of the zero drift can be realized by an additional temperature correction operation on the complete transmitter unit (transmitter and seals).

A thermal isolation or a heating of the capillaries minimises the ambient temperature effect.

Process temperature effect : (mbar/10°C)

Seals	DN 50 / 2" SS	DN 80 / 3" SS	DN 80 / 3" Other diaph. material.	DN 100 / 4" SS	Adaptor SS
for transmitters	diaphragm	diaphragm		diaphragm	diaphragm
FKB/FKM	1.24	0.17	0.73	0.08	0.17
FKD	0.5	0.09	0.22	0.05	0.09

Static pressure effect for ΔP transmitter with stainless steel diaphragms (FKD transmitter with DN80 and DN100 seals) :

Zero shift :

$\pm 0,2\%$ of URL for flange rating, up to 40 bar or 300 lbs

Oil filling	Code digit 7	Density at 25°C	Response time	
			0 to 320 mbar	0 to 1.3 bar
Std silicone oil	Y, G	0,95	0,15	0,037
Fluorinated oil	W,A,D	1,84	0,17	0,04
Oil for vacuum or high temperature	U, X	1,07	0,25	0,065

Response time : (mean values)

The indicated values are in seconds per meter of capillary length with internal tube diameter $\varnothing$ 1 mm.

The indicated response time is based on a pressure change of 0 to 100% of the calibrated span at reference temperature of 20°C.

The indicated values do not include the response time of the transmitter.

Filling fluid of the diaphragm seals :

Code digit 7	Designation	Temperature resistance (°C)		Density (25°C)
		P abs $\geq$ 1 bar	P abs < 1 bar	
Y	Silicone oil	-40 to 180	-40 to 120	0,95
W	Fluorinated oil	-20 to 200	-20 to 120	1,84
F	Sanitary fill fluids	-10 to 250	-10 to 120	0,94
V	Silicone oil		20 to 200	1,07
U	Silicone oil	0 to 300	20 to 200	1,07
X	Silicone oil	-10 to 350	20 to 200	1,09

The indicated values and limits are indicated for the most common applications (standard filling fluids).

Please consult Fuji Electric for special applications indicating your temperature, pressure and vacuum conditions (vacuum and temperature can occur together).

Other filling fluids can be used for your applications.

CODE SYMBOLS - S

1	2	3	4	5	6	7	8	DESCRIPTION
S								Flanged axial diaphragm seal connection
A								Flanged radial diaphragm seal connection - Not possible with rigid mounting design digit 6 : code R
R								Wafer type - Not possible with rigid mounting design digit 6 : code R
W								
								(*1) Flanges RF (Flange size and rating)
4								ANSI-150LB 3"-ISO PN 20 DN 80
5								ANSI-150LB 4"-ISO PN 20 DN 100
6								ANSI-300LB 3"-ISO PN 50 DN 80
7								ANSI-300LB 4"-ISO PN 50 DN 100
8								DIN PN40 DN80
9								DIN PN16 DN100
H								(*2) ANSI-150LB 2"-ISO PN 20 DN 50
J								(*2) ANSI-300LB 2"-ISO PN 50 DN 50
G								(*2) DIN PN40 DN50
U								PN 25 / DN 50 - coupling nut DIN 11851 design material code "V" only
V								PN 40 / DN 50 - coupling nut SMS material code "V" only
W								PN 40 / DN 50 - seal only Clamp material code "V" only
X								No dead volume Sanitary material code "V" only
A								(*3) Flange adaptor PN 40 DN 25 material code "V" - others UR
B								(*3) Flange adaptor ISO PN 20 DN 25 (1"-150 ANSI) material code "V" - others UR
C								(*3) Flange adaptor ISO PN 50 DN 25 (1"- 300 ANSI) material code "V" - others UR
D								(*3) Flange adaptor PN 40 DN 40 material code "V" - others UR
E								(*3) Flange adaptor ISO PN 20 DN 40 (1"1/2 - 150 ANSI) material code "V" - others UR
F								(*3) Flange adaptor ISO PN 50 DN 40 (1"1/2 - 300 ANSI) material code "V" - others UR
S								(*3) Screwed 1/2 NPTE material code "V" - others UR
T								(*3) To be welded (pipe 2"1/2) material code "V" - others UR
								Diaphragm seal material
								Diaphragm Flange raised face Flange
V								SS 316 L SS 316 L SS 316 L
H								(*7) Hastelloy-C Hastelloy-C SS 316 L
B								(*7) Monel Monel SS 316 L
T								(*7) Tantalum Tantalum SS 316 L
P								(*9) (*7) Titanium Titanium SS 316 L
R								(*9) (*7) Zirconium Zirconium SS 316 L
C								(*7) SS 316 L + gold coat SS 316 L SS 316 L
F								(*4) (*7) SS 316L + PFA lining SS 316 L + PFA lining SS 316 L
								Diaphragm seal design
Y								Flush mounting
A								Diaphragm extension 50 mm
B								Diaphragm extension 100 mm material code "V" - digit 4
C								Diaphragm extension 150 mm
D								Diaphragm extension 200 mm
E								Diaphragm extension 50 mm
F								Diaphragm extension 100 mm material code "H" - digit 4
G								Diaphragm extension 150 mm
H								Diaphragm extension 200 mm
J								Diaphragm extension 50 mm
K								Diaphragm extension 100 mm material code "B" - digit 4
L								Diaphragm extension 150 mm
M								Diaphragm extension 200 mm
P								Diaphragm extension 50 mm
R								Diaphragm extension 100 mm material code "T" - digit 4
S								Diaphragm extension 150 mm
T								Diaphragm extension 200 mm
								Transmission diaphragm seal to measuring cell
								Mounting design Capillary length Capillary design
A								Capillary 1,5 m PVC protection
B								Capillary 3 m PVC protection
C								Capillary 6 m PVC protection
D								Capillary Upon request PVC protection
G								(*5) Capillary 1,5 m SS sheald
H								(*5) Capillary 3 m SS sheald
K								(*5) Capillary 6 m SS sheald
L								(*5) Capillary Upon request SS sheald
R								Rigid design - not possible with digit 2 = R, W - max. process temperature : 150°C
								Special applications and fill fluid for the diaphragm seal only
								Treatment Fill fluid
Y								None (standard) Silicone oil
W								None (standard) Fluorinated oil
F								None (standard) Sanitary fill fluid
D								Chlorine service Fluorinated oil
G								Degreasing Silicone oil
A								Oxygen service Fluorinated oil - material code "V" only
N								NACE Silicone oil
V								(*6) Vacuum - max temperature 200°C Silicone oil
U								(*6) Very high temperature (0 to 300°C) - No vacuum
X								(*6) Very high temperature (20 to 350°C) - No vacuum
								Special options or design
-	*							(*8) Special, no code available

* Notes :

- *1 Different flange machinings (recess, groove, ...), consult FUJI Electric.
- *2 Only available with span higher than : 0 to 0,5/5 bar - max process temperature : 150°C - or ask FUJI with operating conditions
- *3 Axial diaphragm seal connection - no extension possible
- *4 Not possible with digit 7 : V, H, T
- *5 Recommended for Vacuum or High Temperature applications T > 120°C - (Capillary internal diameter = 2mm)
- *6 Consult FUJI for your application with the specific operating conditions
- *7 Add values for material options for = DN 80 PN40/ANSI-150LB 3" flange rate, DN 100 or 4" add values available upon request
- *8 When no code can be found in the current code symbols, place "***" in concerned code digit(s) and add "***" in 8th digit
- *9 Max process temperature 150 °C

EMC Directive (2004/108/EC)

All models of **FCX** series transmitters type **FCX-AII** are in accordance with :

- the harmonized standards:
 - EN 61326-1 : 2006 (Electrical equipment for measurement, control and laboratory use - EMC requirements).
 - EN 61326-2-3 : 2006 (Part 2-3 : Particular requirements - Test configuration, operational conditions and performance criteria for transducers with integrated or remote signal conditioning)

Emission limits : EN 61326-1 : 2006

Frequency range (MHz)	Limits	Basic standard
30 to 230	40 dB (µV/m) quasi peak, measured at 10m distance	EN 55011 / CISPR 11 Group 1 Class A
230 to 1000	47 dB (µV/m) quasi peak, measured at 10m distance	

Immunity requirements : EN 61326-1 : 2006 (Table 2)


Phenomenon	Test value	Basic standard	Performance criteria
Electrostatic discharge (EDS)	4 kV (Contact) 8 kV (Air)	EN 61000-4-2 IEC 61000-4-2	B
Electromagnetic field	10V/m (80 to 1000 MHz) 3 V/m (1.4 to 2.0 GHz) 1 V/m (2.0 to 2.7 GHz)	EN 61000-4-3 IEC 61000-4-3	A
Rated power frequency Magnetic field	30 A/m	EN 61000-4-8 IEC 61000-4-8	A
Burst	2 kV (5/50 NS, 5 kHz)	EN 61000-4-4 IEC 61000-4-4	B
Surge	1 kV Line to line 2 kV Line to line	EN 61000-4-5 IEC 61000-4-5	B
Conducted RF	3 V (150 kHz to 80 MHz)	EN 61000-4-6 IEC 61000-4-6	A

Performance criteria :

A : During testing, normal performance within the specification limits.

B : During testing, temporary degradation or loss of function or performance which is self-recovering.

Long mounting design

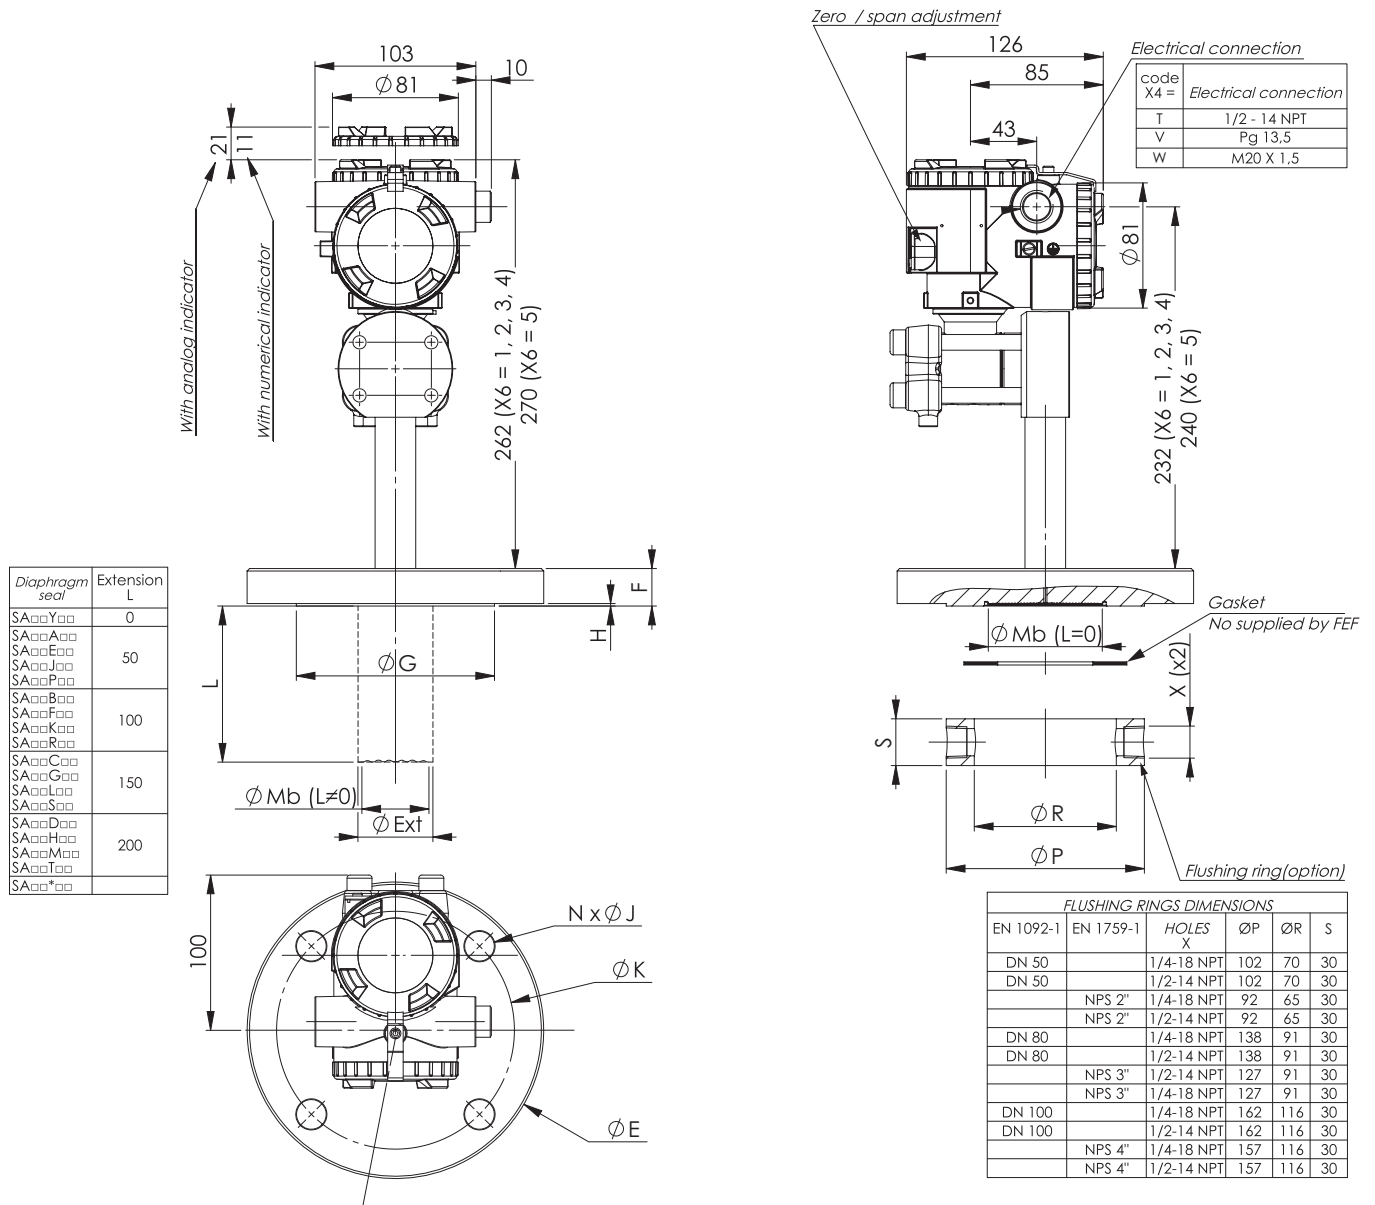

FLANGES DIMENSIONS ACCORDING TO EN 1092-1 & EN 1759-1									SS 316L		Exotic material		
diaphragm seal	EN 1092-1	EN 1759-1	ØE	F min	ØG	H	N x ØJ	ØK	Weight (kg)	L=0 ØMb	L≠0 ØExt=ØMb	L=0 ØMb	L≠0 ØExt(ØMb)
SAG□□□□	DN50 PN40		165	20	102	2	4 x 18	125	3,3	59	48	59	48,3 (47)
SAH□□□□		2" CLASS 150	152	21	92	1,6	4 x 19	120,6	2,7	59	48	59	48,3 (47)
SAJ□□□□		2" CLASS 300	165	22,5	92	1,6	8 x 19	127	3,7	59	48	59	48,3 (47)
SA8□□□□	DN80 PN40		200	24	138	2	8 x 18	160	5,8	73	73	89	76 (72)
SA4□□□□		3" CLASS 150	190	24	127	1,6	4 x 19	152,4	5,3	73	73	89	76 (72)
SA6□□□□		3" CLASS 300	210	28,5	127	1,6	8 x 22,2	168,3	7,8	73	73	89	76 (72)
SA9□□□□	DN100 PN16		220	22	158	2	8 x 18	180	5,9	96	96	89	94 (89)
SA5□□□□		4" CLASS 150	229	24	157	1,6	8 x 19	190,5	7,7	96	96	89	94 (89)
SA7□□□□		4" CLASS 300	254	32	157	1,6	8 x 22,2	200	12,7	96	96	89	94 (89)

Wetted parts material

ØMb = Ø diaphragm
ØExt = extension

WEIGHT: 4 kg (WITHOUT OPTION)

ADD: - FLANGES WEIGHT (SEE TABLE)
- 0,8 kg FOR INDICATOR OPTION
- 2 kg FOR STAINLESS STEEL HOUSING OPTION


X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ X ₈ -X ₉ X ₁₀ X ₁₁ X ₁₂ X ₁₃													SPAN LIMIT	
F K B ☐ ☐ ☐ V F - ☐ ☐ ☐ Y														
X ₁₁ = L, S														
Diaphragm seal : X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ S A ☐ ☐ ☐ ☐														

Diaphragm seal:
X₁ X₂ X₃ X₄ X₅ X₆ X₇
S A □□□□□

X₁₁ = L, S

Outline dimensions for capillary mounted diaphragm seal(s) on a differential pressure transmitter (units:mm) - Dimensions of seals - Refer to page 18 and 19

For PN ≤ 50bar : reduced volume flanges are welded on the measuring cell

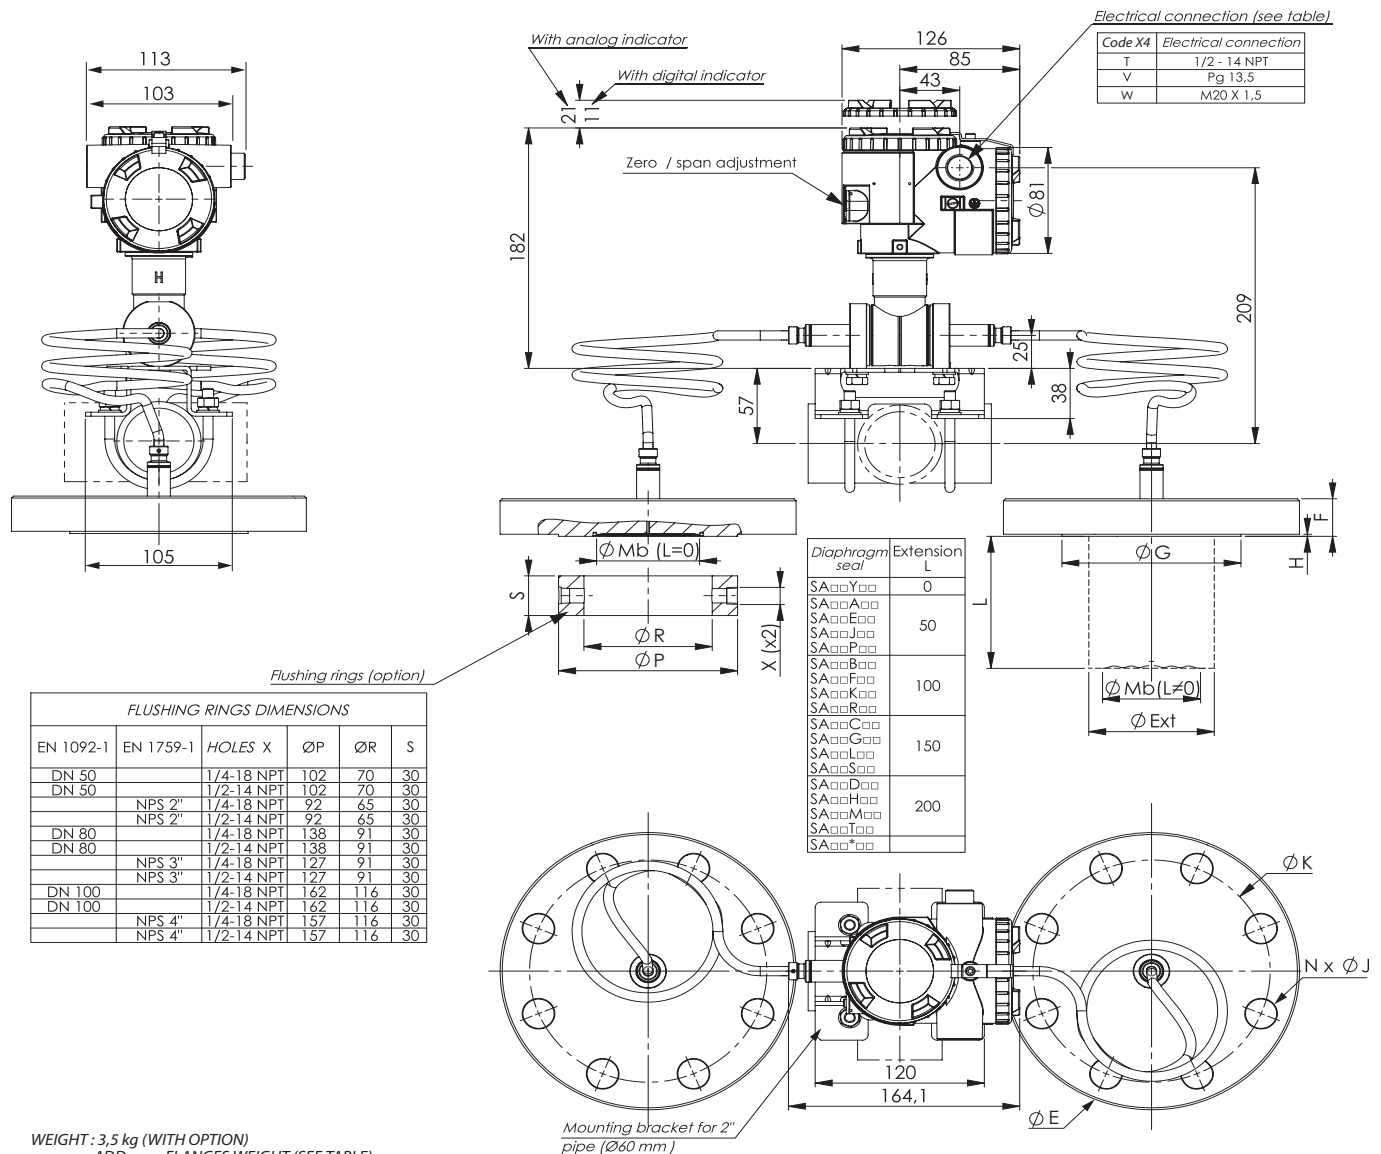


WEIGHT : 3,5 kg (WITH OPTION)
ADD : - FLANGES WEIGHT (SEE TABLE)
- 1 kg PER 50 mm EXTENSION
- 0,8 kg FOR INDICATOR OPTION
- 2 kg FOR STAINLESS STEEL HOUSING OPTION

ØMb = Ø diaphragm
ØExt = Ø extension
Wetted parts material

FLANGES DIMENSIONS ACCORDING TO EN 1092-1 & EN 1759-1										SS 316L Exotic material			
diaphragm seal	EN 1092-1	EN 1759-1	ØE	F min	ØG	H	N x ØJ	ØK	Weight (kg)	L=0 ØMb	L#0 ØExt=ØMb	L=0 ØMb	L#0 ØExt(ØMb)
SAG□□□□	DN50 PN40		165	20	102	2	4 x 18	125	3,3	59	48	59	48,3 (47)
SAH□□□□		2" CLASS 150	152	21	92	1,6	4 x 19	120,6	2,7	59	48	59	48,3 (47)
SAJ□□□□		2" CLASS 300	165	22,5	92	1,6	8 x 19	127	3,7	59	48	59	48,3 (47)
SA8□□□□	DN80 PN40		200	24	138	2	8 x 18	160	5,8	73	73	89	76 (72)
SA4□□□□		3" CLASS 150	190	24	127	1,6	4 x 19	152,4	5,3	73	73	89	76 (72)
SA6□□□□		3" CLASS 300	210	28,5	127	1,6	8 x 22,2	168,3	7,8	73	73	89	76 (72)
SA9□□□□	DN100 PN16		220	22	158	2	8 x 18	180	5,9	96	96	89	94 (89)
SA5□□□□		4" CLASS 150	229	24	157	1,6	8 x 19	190,5	7,7	96	96	89	94 (89)
SA7□□□□		4" CLASS 300	254	32	157	1,6	8 x 22,2	200	12,7	96	96	89	94 (89)

X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ X ₈ - X ₉ X ₁₀ X ₁₁ X ₁₂ X ₁₃	Diaphragm seals :		SPAN LIMIT	
F K D □ □ □ V F □ □ □ □ Y	HP	LP	Min.	Max.
X ₅ = 2, 4, 6, 8, 9	X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇	X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇	FKD□□□ 0,32 KPa (3,2 mbar)	32 KPa (320 mbar)
X ₁₁ = C, H	S A □ □ □ □ □	S A □ □ □ □ □	FKD□□□ 1,3 KPa (13 mbar)	130 KPa (1,3 bar)
			FKD□□□ 5 KPa (50 mbar)	500 KPa (5 bar)

For PN > 50bar : reduced volume flanges are welded and bolted on the measuring cell

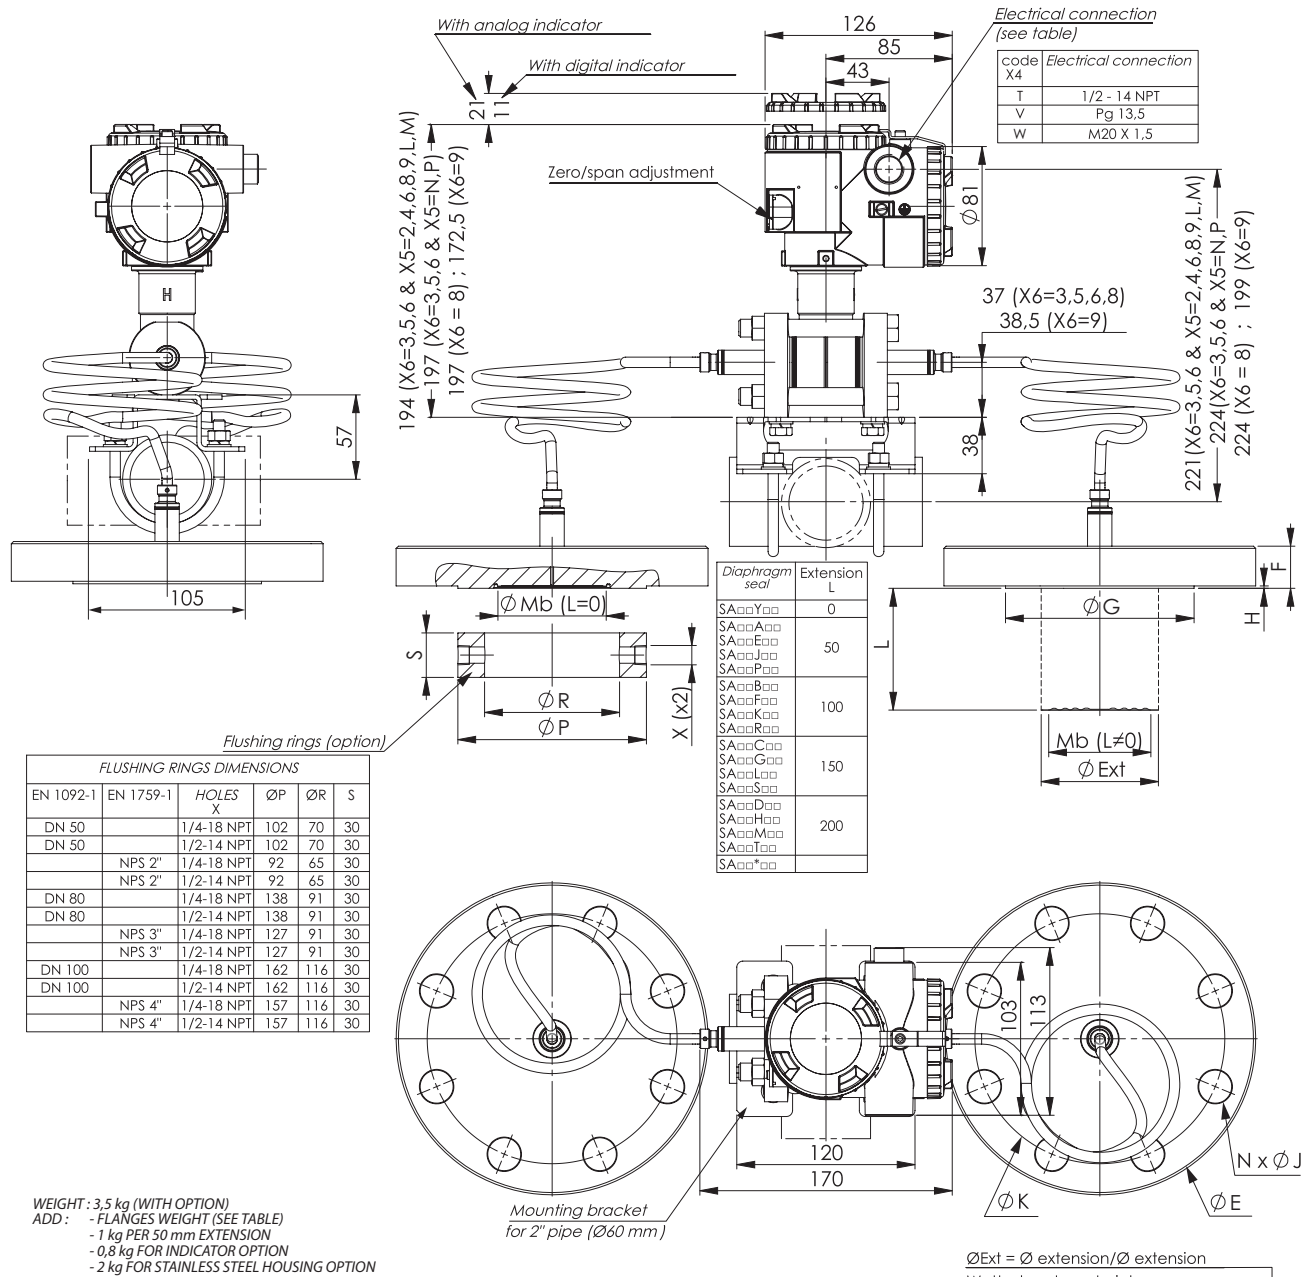


WEIGHT : 3,5 kg (WITH OPTION)
ADD :
- FLANGES WEIGHT (SEE TABLE)
- 1 kg PER 50 mm EXTENSION
- 0,8 kg FOR INDICATOR OPTION
- 2 kg FOR STAINLESS STEEL HOUSING OPTION

FLANGES DIMENSIONS ACCORDING TO EN 1092-1 & EN 1759-1										Wetted parts material			
diaphragm seal	EN 1092-1	EN 1759-1	ØE	F min	ØG	H	N x ØJ	ØK	Weight (kg)	SS 316L		Exotic material	
										L=0 ØMb	L≠0 ØExt=ØMb	L=0 ØMb	L≠0 ØExt(ØMb)
SA00000	DN50 PN40		165	20	102	2	4 x 18	125	3,3	59	48	59	48,3 (47)
SAH0000		2" CLASS 150	152	21	92	1,6	4 x 19	120,6	2,7	59	48	59	48,3 (47)
SAJ0000		2" CLASS 300	165	22,5	92	1,6	8 x 19	127	3,7	59	48	59	48,3 (47)
SA80000	DN80 PN40		200	24	138	2	8 x 18	160	5,8	73	73	89	76 (72)
SA40000		3" CLASS 150	190	24	127	1,6	4 x 19	152,4	5,3	73	73	89	76 (72)
SA60000		3" CLASS 300	210	28,5	127	1,6	8 x 22,2	168,3	7,8	73	73	89	76 (72)
SA90000	DN100 PN16		220	22	158	2	8 x 18	180	5,9	96	96	89	94 (89)
SA50000		4" CLASS 150	229	24	157	1,6	8 x 19	190,5	7,7	96	96	89	94 (89)
SA70000		4" CLASS 300	254	32	157	1,6	8 x 22,2	200	12,7	96	96	89	94 (89)

X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ X ₈ -X ₉ X ₁₀ X ₁₁ X ₁₂ X ₁₃	Diaphragm seals :		SPAN LIMIT		
F K D V F - Y	HP	LP	Min.	Max.	
X ₁₁ = C, H	X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇	X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇	FKD003	0,32 KPa (3,2 mbar)	32 KPa (320 mbar)
	S A	S A	FKD005	1,3 KPa (13 mbar)	130 KPa (1,3 bar)
			FKD006	5 KPa (50 mbar)	500 KPa (5 bar)
			FKD008	30 KPa (300 mbar)	3 MPa (30 bar)

Outline dimensions for capillary mounted diaphragm seal(s) on a gauge or an absolute pressure transmitter (units:mm) - Dimensions of seals - Refer to page 18 and 19


For PN ≤ 50bar : reduced volume flanges are welded on the measuring cell

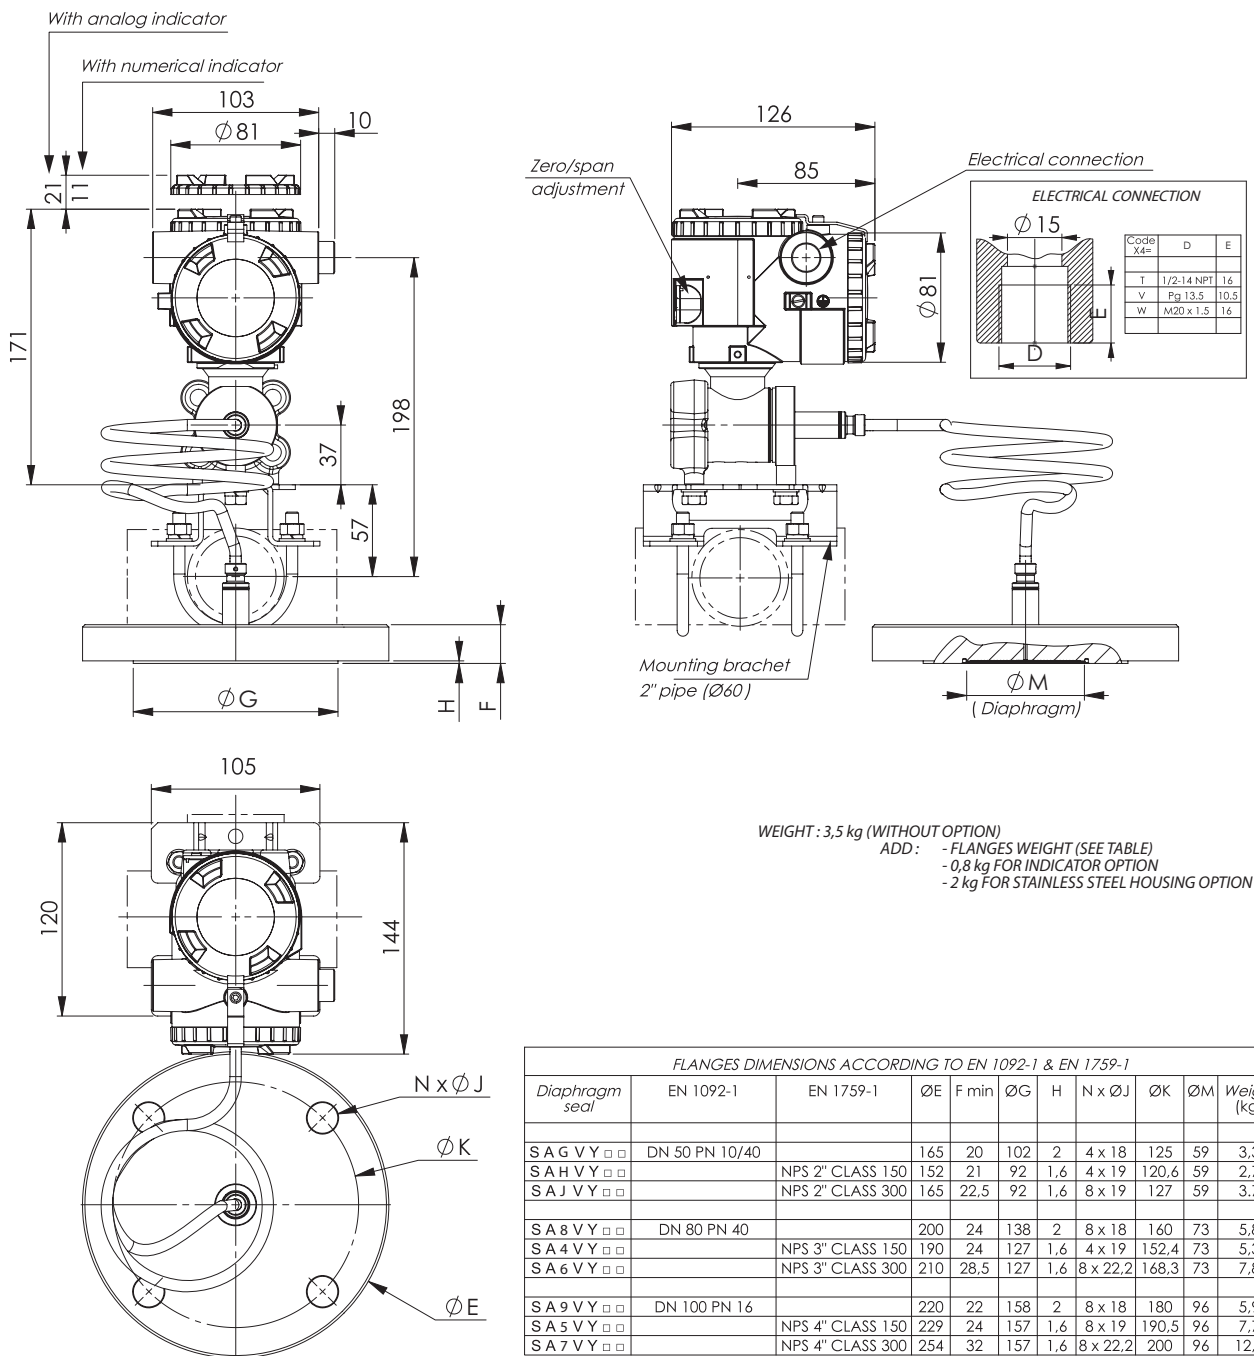

X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ X ₈ -X ₉ X ₁₀ X ₁₁ X ₁₂ X ₁₃ F K B ☐ ☐ ☐ V F - ☐ ☐ ☐ Y	Diaphragm seal : X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ S A ☐ V Y ☐ ☐		SPAN LIMIT	
			Min.	Max.
		FKB ☐ ☐ 1	1,3 kPa (0,013 bar)	100 kPa (1,3 bar)
		FKB ☐ ☐ 2	5 kPa (0,05 bar)	500 kPa (5 bar)
		FKB ☐ ☐ 3	30 kPa (0,3 bar)	3 MPa (30 bar)

X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ X ₈ -X ₉ X ₁₀ X ₁₁ X ₁₂ X ₁₃ F K M ☐ ☐ ☐ V F - ☐ ☐ ☐ Y	Diaphragm seal : X ₁ X ₂ X ₃ X ₄ X ₅ X ₆ X ₇ S A ☐ V Y ☐ ☐		SPAN LIMIT	
			Min.	Max.
		FKM ☐ ☐ 1	0,016 bar abs	0,16 bar abs
		FKM ☐ ☐ 2	0,013 bar abs	1,3 bar abs
		FKM ☐ ☐ 3	0,05 bar abs	5 bar abs
		FKM ☐ ☐ 4	0,3 bar abs	30 bar abs

For PN > 50bar : reduced volume flanges are welded and bolted on the measuring cell

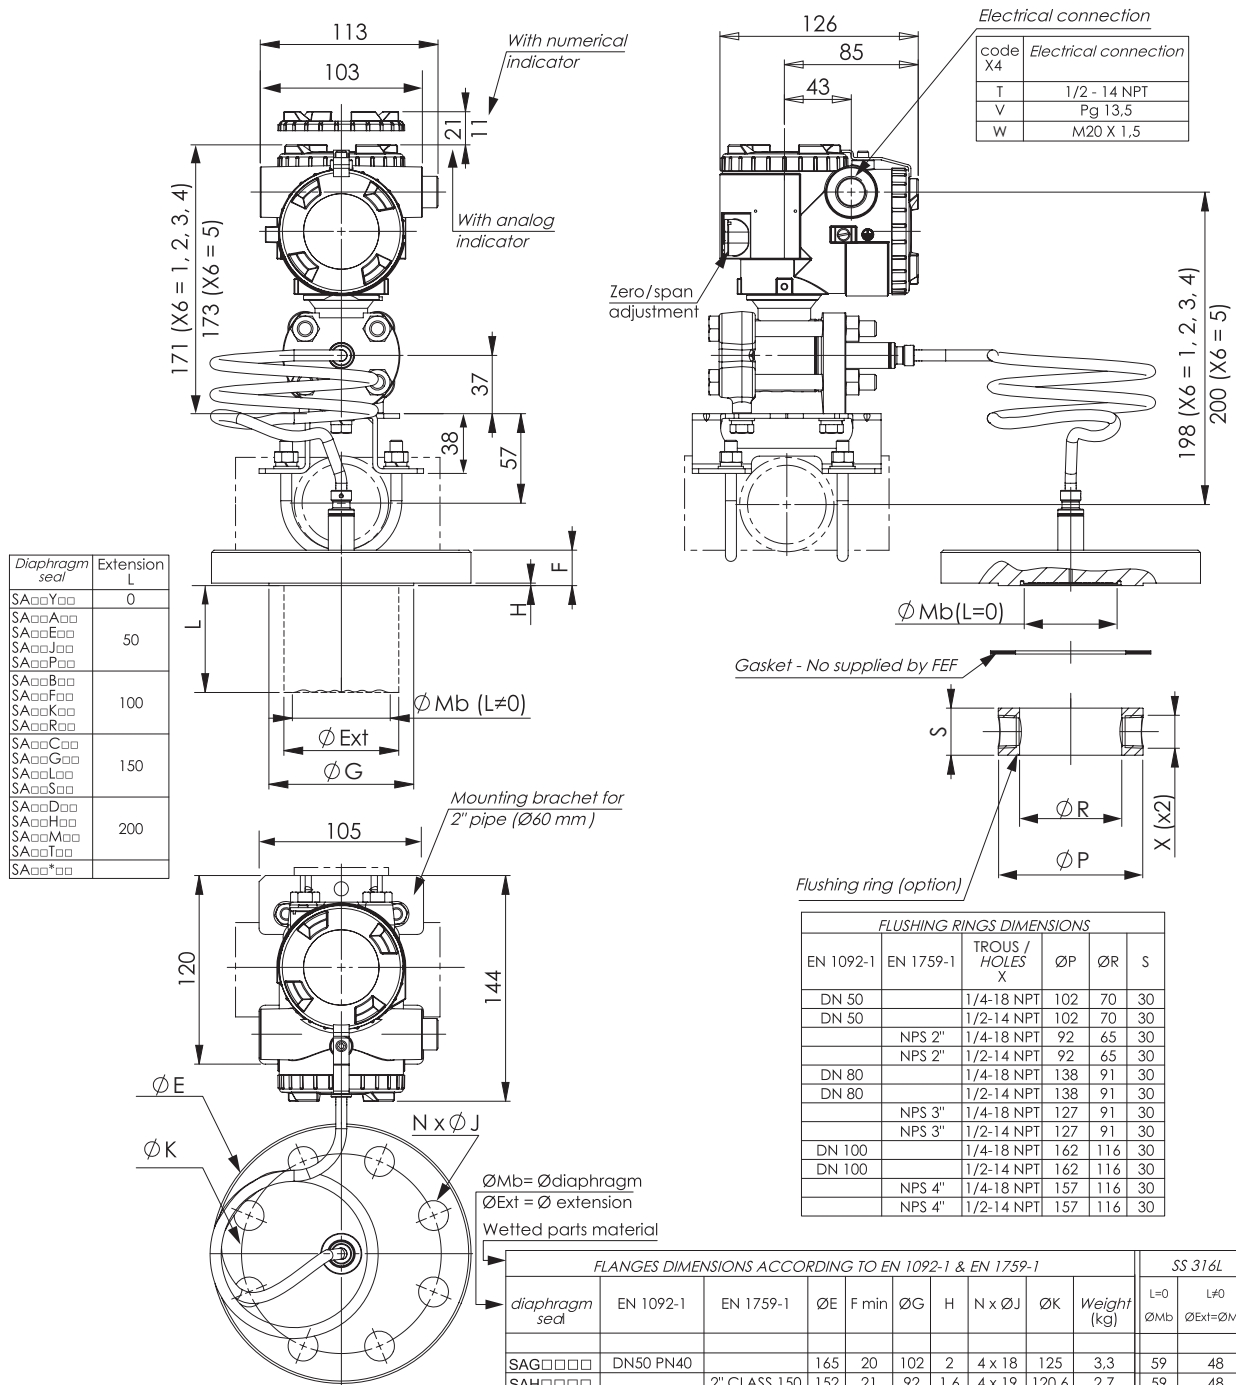


WEIGHT : 3,5 kg (WITHOUT OPTION)
 ADD :
 - FLANGES WEIGHT (SEE TABLE)
 - 1 kg PER 50 MM EXTENSION
 - 0,8 kg FOR INDICATOR OPTION
 - 2 kg FOR STAINLESS STEEL HOUSING OPTION

FLANGES DIMENSIONS ACCORDING TO EN 1092-1 & EN 1759-1										SS 316L Exotic material			
diaphragm seal	EN 1092-1	EN 1759-1	ϕE	F min	ϕG	H	N x ϕJ	ϕK	Weight (kg)	L=0 ϕMb	L $\neq 0$ $\phi Ext = \phi Mb$	L=0 ϕMb	L $\neq 0$ $\phi Ext = \phi Mb$
SA00000	DN50 PN40		165	20	102	2	4 x 18	125	3.3	59	48	59	48,3 (47)
SAH0000		2" CLASS 150	152	21	92	1,6	4 x 19	120,6	2,7	59	48	59	48,3 (47)
SAJ0000		2" CLASS 300	165	22,5	92	1,6	8 x 19	127	3,7	59	48	59	48,3 (47)
SA80000	DN80 PN40		200	24	138	2	8 x 18	160	5,8	73	73	89	76 (72)
SA40000		3" CLASS 150	190	24	127	1,6	4 x 19	152,4	5,3	73	73	89	76 (72)
SA60000		3" CLASS 300	210	28,5	127	1,6	8 x 22,2	168,3	7,8	73	73	89	76 (72)
SA90000	DN100 PN16		220	22	158	2	8 x 18	180	5,9	96	96	89	94 (89)
SA50000		4" CLASS 150	229	24	157	1,6	8 x 19	190,5	7,7	96	96	89	94 (89)
SA70000		4" CLASS 300	254	32	157	1,6	8 x 22,2	200	12,7	96	96	89	94 (89)

FLANGES DIMENSIONS ACCORDING TO EN 1092-1 & EN 1759-1										SS 316L Exotic material			
diaphragm seal	EN 1092-1	EN 1759-1	ϕE	F min	ϕG	H	N x ϕJ	ϕK	Weight (kg)	L=0 ϕMb	L $\neq 0$ $\phi Ext = \phi Mb$	L=0 ϕMb	L $\neq 0$ $\phi Ext = \phi Mb$
SA00000	DN50 PN40		165	20	102	2	4 x 18	125	3.3	59	48	59	48,3 (47)
SAH0000		2" CLASS 150	152	21	92	1,6	4 x 19	120,6	2,7	59	48	59	48,3 (47)
SAJ0000		2" CLASS 300	165	22,5	92	1,6	8 x 19	127	3,7	59	48	59	48,3 (47)
SA80000	DN80 PN40		200	24	138	2	8 x 18	160	5,8	73	73	89	76 (72)
SA40000		3" CLASS 150	190	24	127	1,6	4 x 19	152,4	5,3	73	73	89	76 (72)
SA60000		3" CLASS 300	210	28,5	127	1,6	8 x 22,2	168,3	7,8	73	73	89	76 (72)
SA90000	DN100 PN16		220	22	158	2	8 x 18	180	5,9	96	96	89	94 (89)
SA50000		4" CLASS 150	229	24	157	1,6	8 x 19	190,5	7,7	96	96	89	94 (89)
SA70000		4" CLASS 300	254	32	157	1,6	8 x 22,2	200	12,7	96	96	89	94 (89)

Outline dimensions of the standard diaphragm seals - Flush/extension (units : mm)

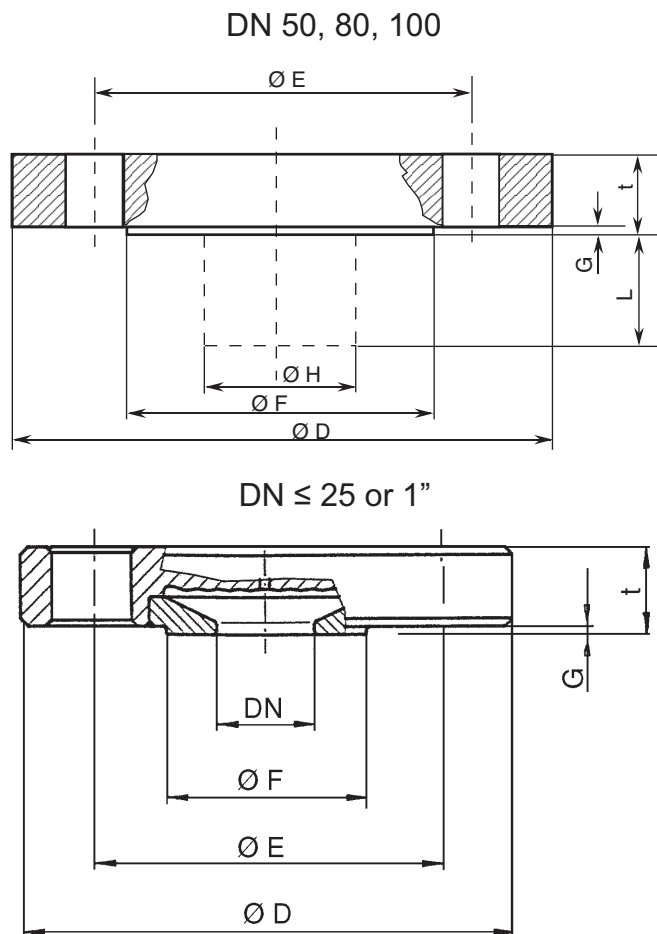


FLANGE DIMENSIONS ACCORDING DIN 2501 ET B16.5


DIN / ISO		ANSI		ØD	ØE	ØF	G	ØH	t	N x Øh
PN	DN	NP	NW							
40	15			95	65	45	2		22	4 x 14
40	20			105	75	58	2		22	4 x 14
40	25			115	85	68	2		22	4 x 14
40	50			165	125	102	3	48	20	4 x 18
40	80			200	160	138	3	73	20	8 x 18
16	100			220	180	158	3	96	20	8 x 18
20	15	150 lbs	1/2"	95	60,5	35	2		22	4 x 16
20	20	150 lbs	3/4"	100	70	43	2		22	4 x 16
20	25	150 lbs	1"	110	79,5	51	2		22	4 x 16
50	15	300 lbs	1/2"	95	66,5	35	2		22	4 x 16
50	20	300 lbs	3/4"	120	82,5	43	2		22	4 x 20
50	25	300 lbs	1"	125	89	51	2		22	4 x 20
20	50	150 lbs	2"	150	120,5	92	1,6	48	20	4 x 20
20	80	150 lbs	3"	190	152,5	127	1,6	73	24	4 x 20
20	100	150 lbs	4"	230	190,5	158	1,6	96	24	8 x 20
50	50	300 lbs	2"	165	127	92	1,6	48	22,5	8 x 20
50	80	300 lbs	3"	210	168,5	127	1,6	73	29	8 x 22
50	100	300 lbs	4"	255	200	158	1,6	96	32	8 x 22

Outline dimensions of diaphragm seals with adaptors (units : mm)

Flange adaptor

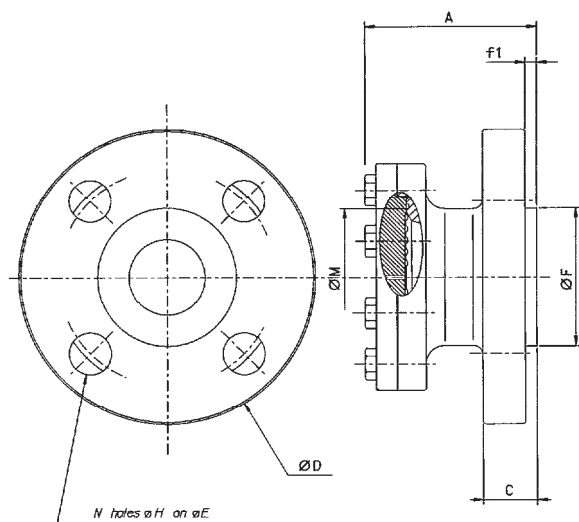

Screwed adaptor

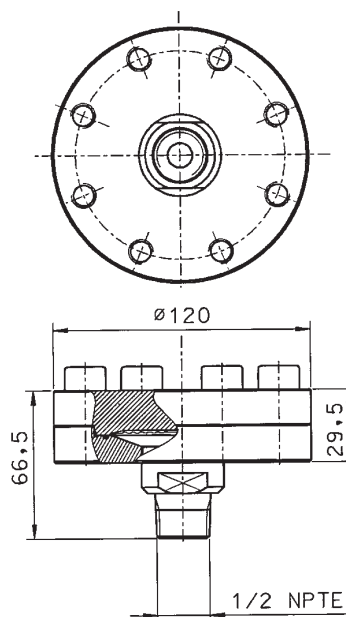

FLANGES DIMENSIONS										
DIN		ANSI		ØD	ØE			ØF	Cmin	f1
PN	DN	Pe	DN			N	ØH			A
40	25			115	85	4	14	68	18	2
20	25	150	1"	108	79,5	4	15,8	50,8	16	1,6
50	25	300	1"	124	89	4	19	50,8	17,5	1,6
40	40			150	110	4	18	88	18	3
20	40	150	1 1/2"	127	98,4	4	15,8	73	18	16
50	40	300	1 1/2"	156	114,3	4	22,2	73	21	1,6


Outline dimensions of sanitary diaphragm (units : mm)

The seals for the sanitary and pharmaceutical applications are available DIN, SMS and Tri Clamp standards

Seals according DIN 11851 and SMS standard

2 different designs exist for DIN 11851 and SMS : (d_M = diaphragm active diameter)


Coupling nut design

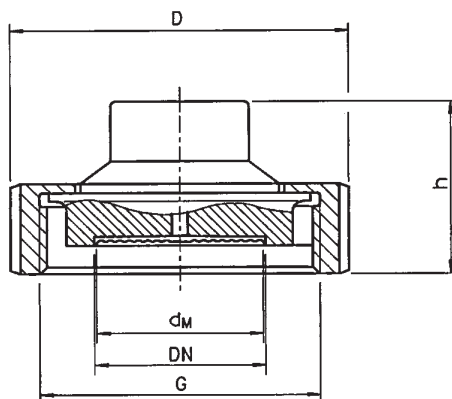

DIN 11851

DN	PN (Max)	D	h	d_M	G
25	40	63	36	25	Rd 52 x 1/6
32	40	70	36	32	Rd 58 x 1/6
40	40	78	36	40	Rd 65 x 1/6
50	40	112	36	52	Rd 78 x 1/6
65	40	112	36	65	Rd 95 x 1/6
80	40	127	36	76	Rd 110 x 1/4


Male thread design

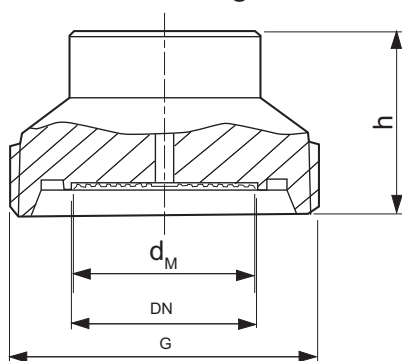

SMS


DN	PN (Max)	D	h	d_M	G
25	40	51	38	25	Rd 40 x 1/6
32	40	60	38	32	Rd 48 x 1/6
38	40	74	38	40	Rd 60 x 1/6
51	40	84	38	52	Rd 70 x 1/6
63.5	40	100	38	65	Rd 85 x 1/6
76	40	114	38	76	Rd 98 x 1/4

Tri Clamp design

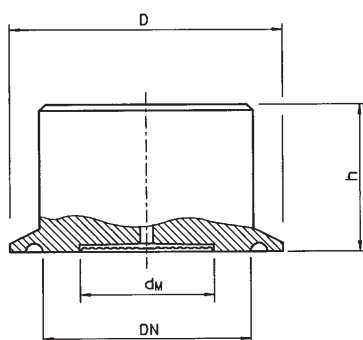


DN	PN (Max)	D	h	d_M
1 1/2"	40	50,5	35	32
2"	40	64	35	40
2 1/2"	40	77,5	35	50
3"	40	91	35	65

Dead volume seal

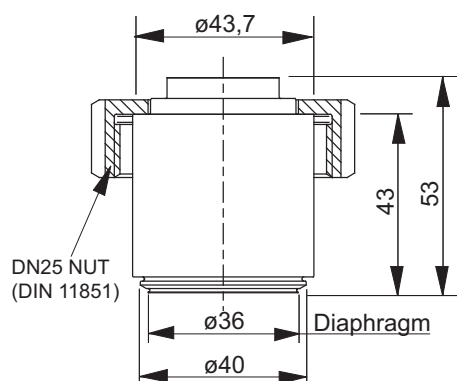

CONNECTION DIAGRAM

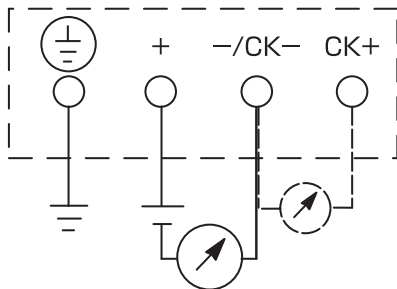

Fuji Electric France S.A.S.

46 rue Georges Besse - ZI du brézet - 63039 Clermont ferrand

Tél : 04 73 98 26 98 - Fax : 04 73 98 26 99

Mail : sales.dpt@fujielectric.fr - web : www.fujielectric.fr

Fuji Electric can accept no responsibility for possible errors in catalogues, brochures and other printed material. Fuji Electric reserves the right to alter its products without notice. This also applies to products already on order provided that such alterations can be made without subsequential changes being necessary in specifications already agreed. All trademarks in this material are property of the respective companies. all rights reserved.